


FLASHINGS W/LESS THAN 8" (20cm) MIN.  
HEIGHT REQUIRING A SEALED TERMINATION

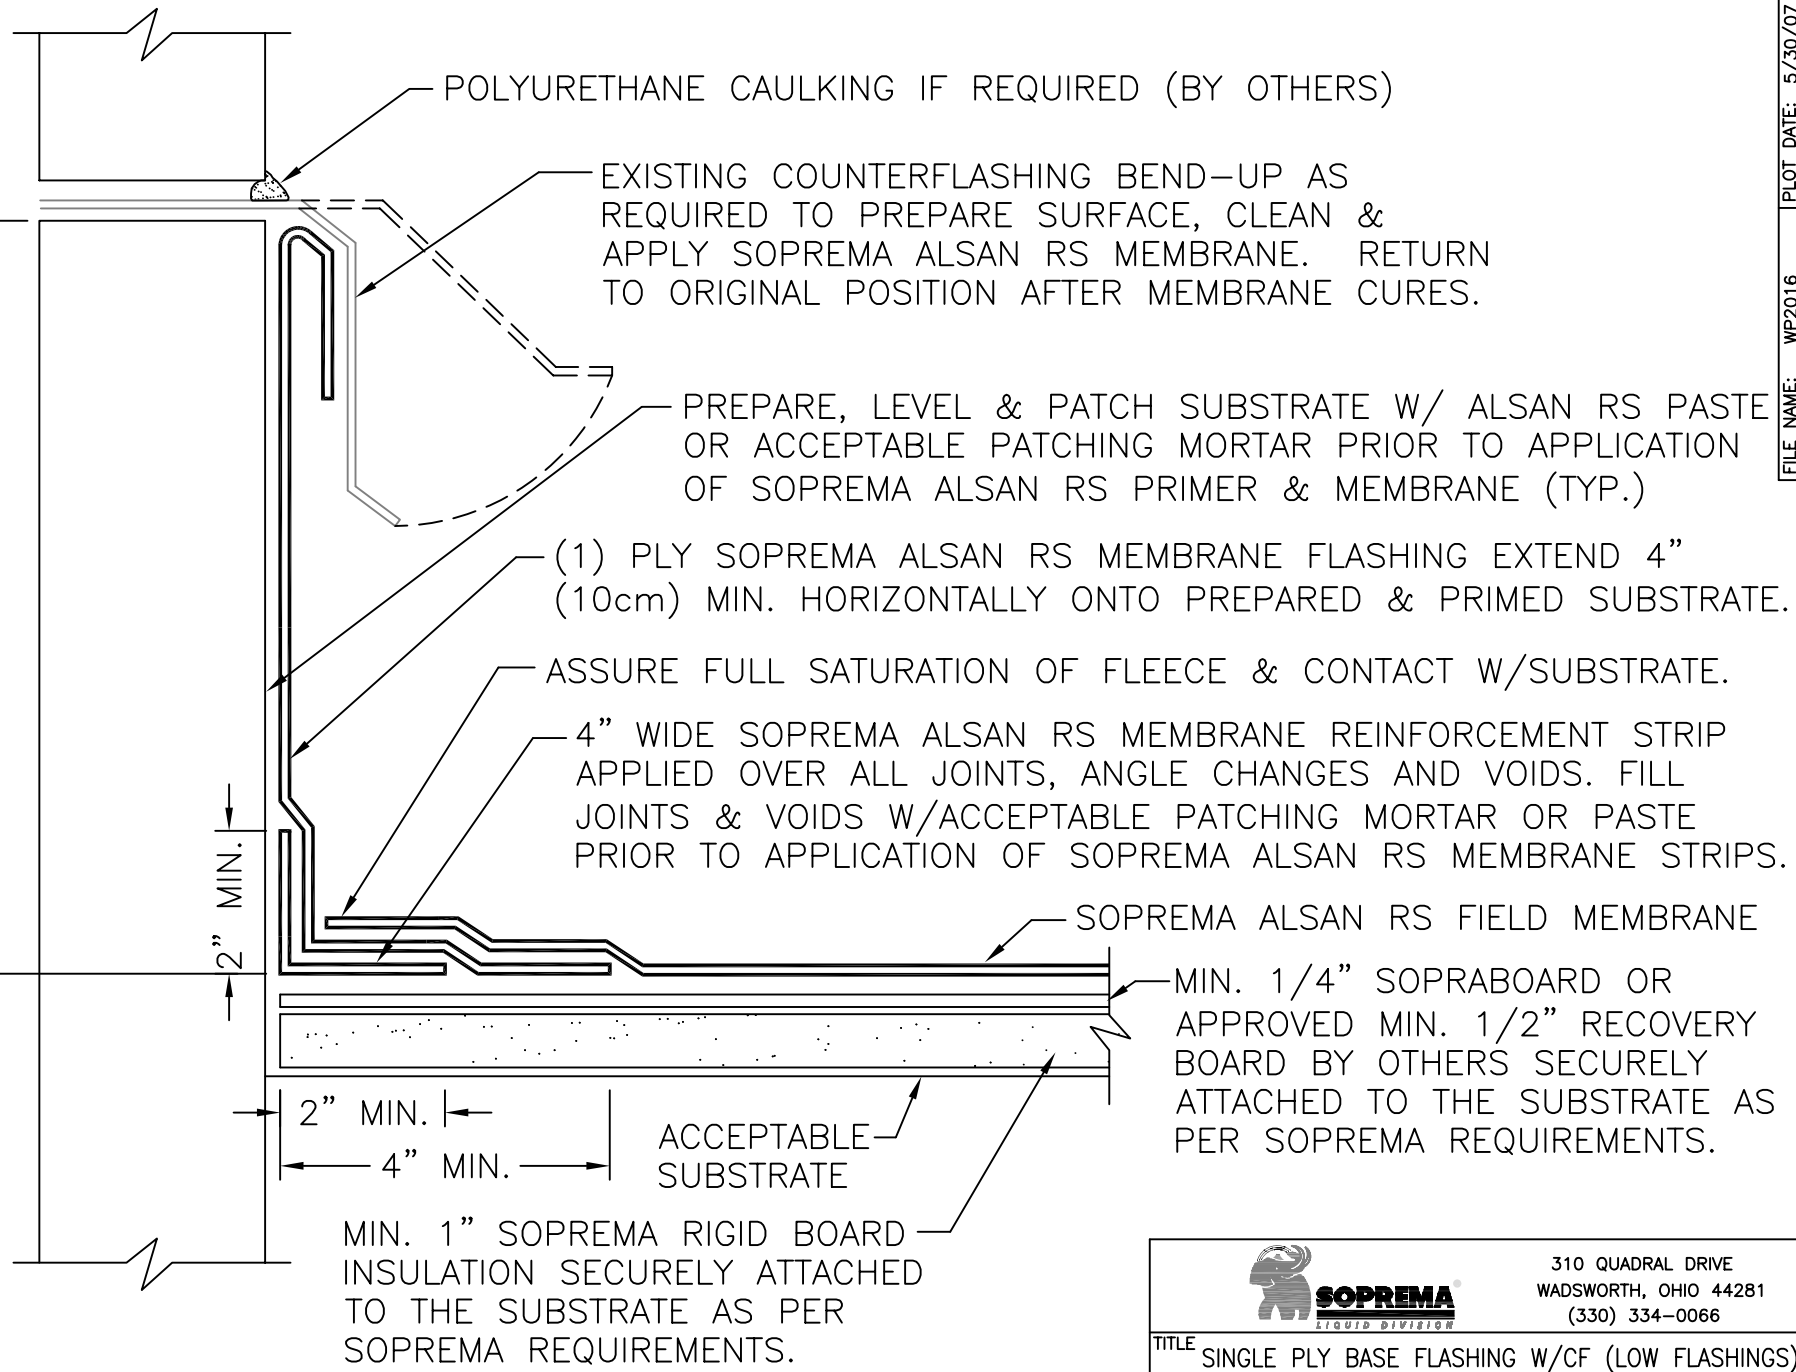

POLYURETHANE CAULKING IF REQUIRED (BY OTHERS)

EXISTING COUNTERFLASHING BEND-UP AS REQUIRED TO PREPARE SURFACE, CLEAN & APPLY SOPREMA ALSAN RS MEMBRANE. RETURN TO ORIGINAL POSITION AFTER MEMBRANE CURES.

PREPARE, LEVEL & PATCH SUBSTRATE W/ ALSAN RS PASTE OR ACCEPTABLE PATCHING MORTAR PRIOR TO APPLICATION OF SOPREMA ALSAN RS PRIMER & MEMBRANE (TYP.)

(1) PLY SOPREMA ALSAN RS MEMBRANE FLASHING EXTEND 4" (10cm) MIN. HORIZONTALLY ONTO PREPARED & PRIMED SUBSTRATE.

ASSURE FULL SATURATION OF FLEECE & CONTACT W/SUBSTRATE.


4" WIDE SOPREMA ALSAN RS MEMBRANE REINFORCEMENT STRIP APPLIED OVER ALL JOINTS, ANGLE CHANGES AND VOIDS. FILL JOINTS & VOIDS W/ACCEPTABLE PATCHING MORTAR OR PASTE PRIOR TO APPLICATION OF SOPREMA ALSAN RS MEMBRANE STRIPS.

SOPREMA ALSAN RS FIELD MEMBRANE

MIN. 1/4" SOPRABOARD OR APPROVED MIN. 1/2" RECOVERY BOARD BY OTHERS SECURELY ATTACHED TO THE SUBSTRATE AS PER SOPREMA REQUIREMENTS.

2" MIN.  
4" MIN.  
ACCEPTABLE SUBSTRATE  
MIN. 1" SOPREMA RIGID BOARD INSULATION SECURELY ATTACHED TO THE SUBSTRATE AS PER SOPREMA REQUIREMENTS.

NOTES:  
1. DETAIL TO BE USED IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281	
		(330) 334-0066	
TITLE SINGLE PLY BASE FLASHING W/CF (LOW FLASHINGS)			
SCALE	DWN	CHK	APPROVAL DATE
NONE	DMT	MT	5/30/07
DRAWING NUMBER			REV
BI-7-RS			0

\*\* USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.