

EXTEND SURFACE PREP MAX. 1/8" BEYOND LINE OF SOPREMA ALSAN RS FLASHING & COVER W/ SOPREMA ALSAN RS COATING

4" WIDE SOPREMA ALSAN RS MEMBRANE REINFORCEMENT STRIP APPLIED OVER ALL JOINTS, ANGLE CHANGES AND VOIDS. FILL JOINTS & VOIDS W/ACCEPTABLE SOPREMA PATCHING MORTAR OR PASTE PRIOR TO APPLICATION OF SOPREMA ALSAN RS MEMBRANE STRIPS.

MIN. 1/4" SOPRABOARD OR APPROVED MIN. 1/2" RECOVERY BOARD BY OTHERS SECURELY ATTACHED TO THE SUBSTRATE AS PER SOPREMA REQUIREMENTS.

MIN. 1" SOPREMA RIGID BOARD INSULATION SECURELY ATTACHED TO THE SUBSTRATE AS PER SOPREMA REQUIREMENTS.

6" (15cm) MIN.

2" MIN.

POWER TOOL CLEAN TUBE STEEL PER SSPC-SP3.

SOPREMA ALSAN RS MEMBRANE SKIRT WRAPPED AROUND PIPE W/ 2" (5cm) MIN. OVERLAP


SOPREMA ALSAN RS FIELD MEMBRANE

SOPREMA ALSAN RS MEMBRANE COLLAR CUT INSIDE DIA. SAME SIZE AS PIPE DIAMETER

2" MIN.


2" MIN.

ACCEPTABLE SUBSTRATE

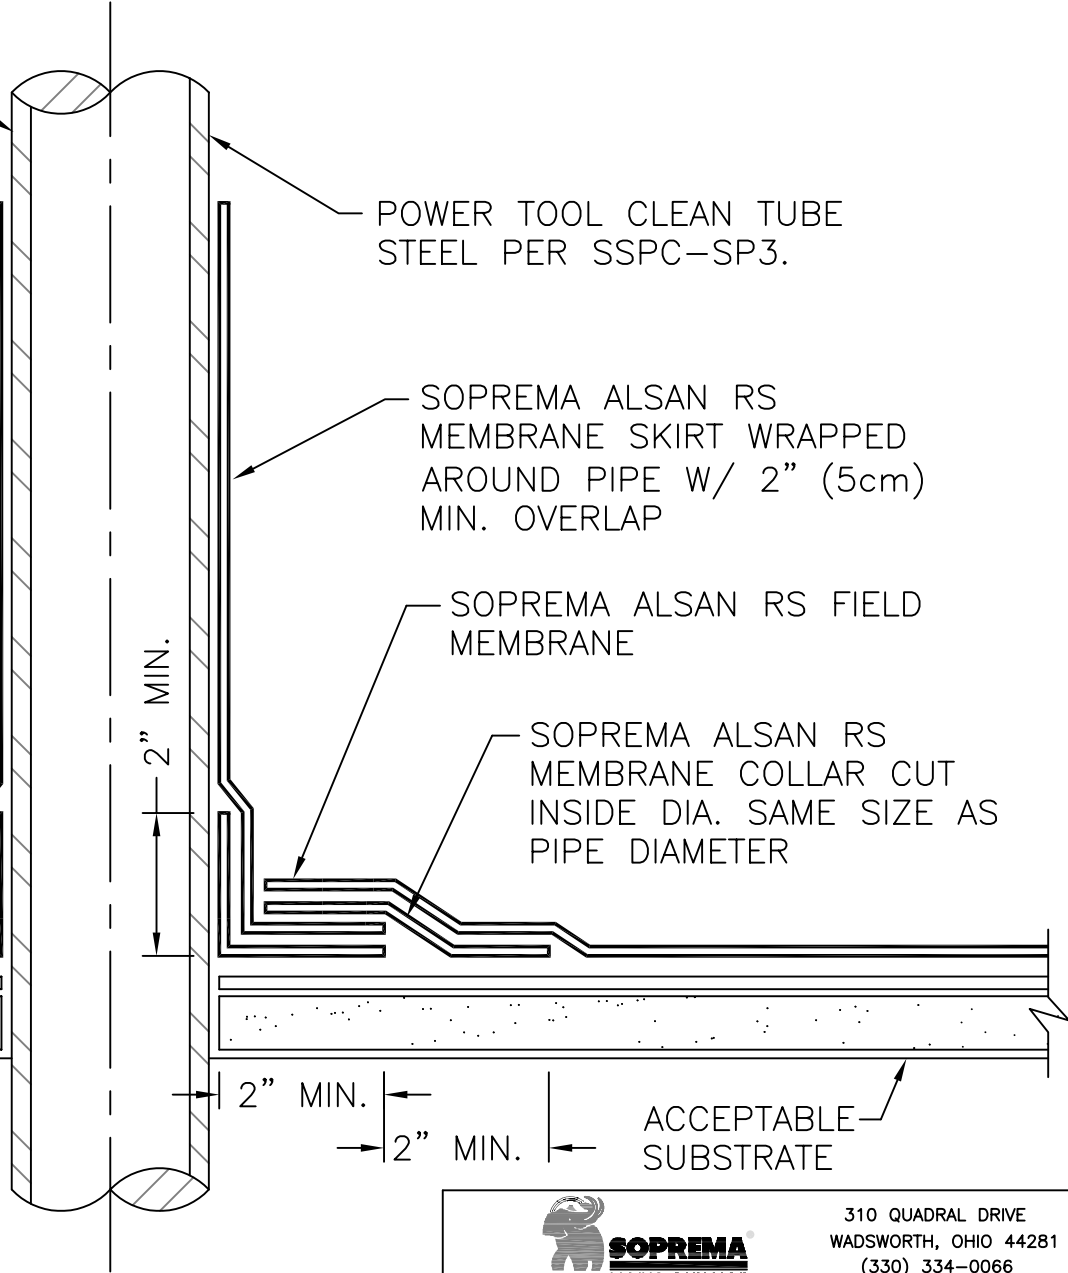

NOTES:

1. DETAIL TO BE USED IN CONJUNCTION WITH SOPREMA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.

		310 QUADRAL DRIVE	
		WADSWORTH, OHIO 44281	
		(330) 334-0066	
TITLE PIPE PENETRATION FLASHING			
SCALE NONE	DWN DMT	CHK MT	APPROVAL DATE 3/20/07
DRAWING NUMBER PI-1-RS			REV 0

** USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.