

SEE JOINT SECTION BELOW
CAULK MUST EXTEND DOWN
OUTSIDE FACE OF WALL.

NOTE:
WHEN APPROVED, THIS DETAIL MAY BE USED
WHERE ALSAN RS FLASH MEMBRANE CAN NOT
BE APPLIED ON OUTSIDE WALL FACE. SEALANT
BY OTHERS IS CONSIDERED A MAINTENANCE
ITEM EXCLUDED FROM WARRANTY.

JOINT FLASHING
PER STANDARD
ALT DETAILS.

ALSAN RS FLASH MEMBRANE
FLASHING ENDED @ OUTSIDE
HORIZONTAL COPING EDGE

ALSAN RS FIELD
MEMBRANE

ALSAN RS FLASH MEMBRANE
PARAPET FLASHING - SEE
TYPICAL DETAILS

VIEW @ PARAPET WALL

ACCEPTABLE CONTINUOUS JOINT SEALANT
REMOVE & REPLACE AS REQ'D. (BY OTHERS)

EXISTING WALL PANEL
JOINT OPENING

(2) PLY STEPPED ALSAN RS FLASH MEMBRANE
JOINT FLASHING APPLIED CONTINUOUSLY
CENTERED OVER DE-BOND TAPE & JOINT (TYP.)

4" (10 cm)
(MIN.)

2" (5 cm)
(MIN.)

ALSAN RS FLASH MEMBRANE LAPPED
LAPPED ONTO JOINT FLASHING BOTH
SIDES OF JOINT (TYP.)

DE-BONDING TAPE SIZED TO ACCOMMODATE
MOVEMENT & CENTERED OVER JOINT.

PREFORMED COMPRESSIBLE FILLER OR
BACKER ROD SIZED FOR OPENING.

NOTE:
SIZE WIDTH OF DE-BONDING TAPE TO PROVIDE
UN-ADHERED AREA MINIMUM 5 TIMES LARGER
THAN THE MAXIMUM ANTICIPATED EXPANSION.
MEMBRANE COVER STRIP MUST EXTEND PAST
DE-BONDING TAPE 4" MINIMUM ALL SIDES (TYP.)


SECTION THRU JOINT

SCALE: NTS

NOTE: REFER TO SOPREMA RELATED PUBLISHED DOCUMENTATION, PRODUCT DATA SHEETS (PDS) & SAFETY DATA SHEETS (SDS) FOR ADDITIONAL INFORMATION. ALL DETAIL DRAWINGS & RELATED INSTALLATION GUIDELINES ARE PROVIDED BY SOPREMA FOR THE SOLE PURPOSE OF SOPREMA WARRANTY QUALIFICATION. ACCORDINGLY, ANY DETAILS DRAWINGS PROVIDED ARE NOT OFFERED AND SHOULD NOT BE CONSIDERED A SUBSTITUTE FOR PROFESSIONAL DESIGN SERVICES. USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL, PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.

ALSAN RS WATERPROOFING MEMBRANE COPING JOINT FLASHING (CAULKED)

DRAWING NO.:
RS-J4C

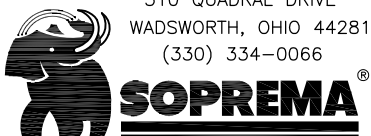

REVISION
0

ISSUE DATE
12-15-2018

SCALE
N.T.S.

DRAWN BY
DRW

RS_J04C